

Pull-out unit for beams

200kgs load capacity | 100% pull-out

Pull-out units can be integrated into existing pallet racks. They are placed on the cross beams and bolted in the rear area. The pull-out unit is delivered fully assembled. A fastening set is included in the scope of delivery.

Product details


Load capacity	200 kgs (evenly loaded)
Pull-out depth	100 %
Material	Steel
Empty weight	40 kgs (short side handling) 41 kgs (long side handling)
Suitable for rack depth	970 - 1,170 mm (short side handling) 570 - 770 mm (long side handling)
Configuration	Raised edges on all 4 sides Steel shelf panel Black handle
Commodity code	73089098
Unit	1 piece
Max. quantity / pallet	10 pieces

Versions

Dimension (WxDxH)	Handling	Colour	Art-No.
820 x 1,273 x 81 mm	Short side	RAL 5010	12105010
820 x 1,273 x 81 mm	Short side	RAL 7024	12107024
1,220 x 873 x 81 mm	Long side	RAL 5010	12105010Q
1,220 x 873 x 81 mm	Long side	RAL 7024	12107024Q



Full extended pull-out unit



Closed pull-out unit




Built-in pull-out unit

LOAD	PULL-OUT	COLOUR	COLOUR	MAX. QUANTITY/ PALLET
200	100	5010	7024	10

Pull-out unit for beams

200kgs load capacity | 100% pull-out

Engineering drawing

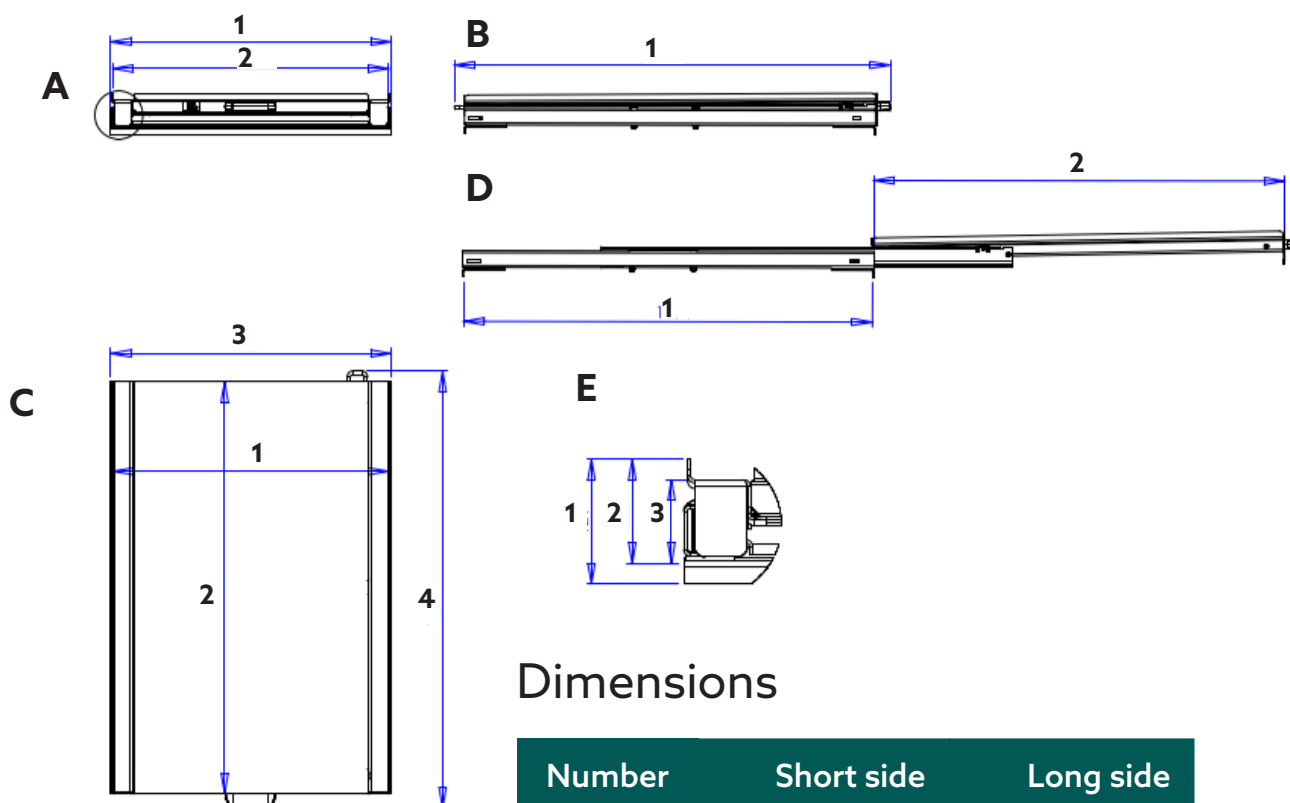

Dimensions

Number	Short side	Long side
A 1	820 mm	1,220 mm
A 2	806 mm	1,206 mm
B 1	1,273 mm	809 mm
C 1	806 mm	1,206 mm
C 2	1,202 mm	809 mm
C 3	820 mm	1,220 mm
C 4	1,273 mm	873 mm
D 1	1,194 mm	884 mm
D 2	1,200 mm	794 mm
E 1	121 mm	120 mm
E 2	101 mm	99 mm
E 3	81 mm	81 mm

Mounting kit

Screws	Beams
M8 x 140	For beam height up to 115 mm
Screws for other beam heights on request	

Pull-out unit for beams

200kgs load capacity | 100% pull-out

Important safety instructions

- The pallet rack must be securely anchored to the floor. Please follow the assembly and safety instructions of the rack manufacturer
- Beams must be firmly screwed to the support uprights (at least M8 screws)
- Pull-out units must be fixed using the bolts, nuts, washers and counterplates supplied according to the assembly instructions
- Depending on the different pull-out units and the length of the beams, the rack must have a minimum shelf load according to the table below
- Maximal load capacity of pull-out unit with evenly distributed load as well as safety instructions are attached to the units
- If there are several pull-out units on one beam, only one unit is allowed to be pulled-out at a time
- If there are several levels with pull-out units, only one unit may be extended at a time
- Immediately after using the pull-out unit, it must be pushed back again and it must be ensured that it is locked in place

Necessary shelf load of the beams

L = 950 mm 1 pull-out unit	L = 1,850 mm 2 pull-out units next to each other	L = 2,700 mm 3 pull-out units next to each other
643 kgs	886 kgs	1,129 kgs

Data sheet, status 09.2024

Errors and omissions excepted. All values are approximate.

Pictures may show accessories or other products.